


FLOOR TEMPERATURE
SENSOR WIRE INSTALLED
UNDER TILE.

SIGNAL WIRES
FROM THERMOSTAT
TO RELAY

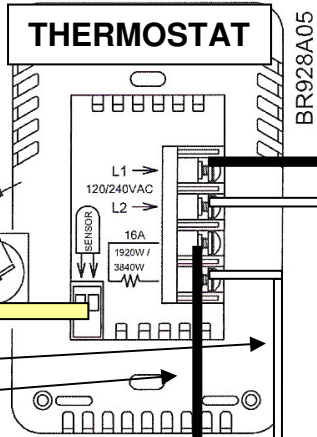

120 VOLT SUPPLY
FROM SERVICE PANEL


240 VOLT GFCI
CIRCUIT 2

240 VOLT GFCI
CIRCUIT 1

240 VOLT GFCI
CIRCUIT 3

240 VOLT GFCI
CIRCUIT 4

RELAY and HEATER ELECTRICAL HOOK UP INSTRUCTIONS

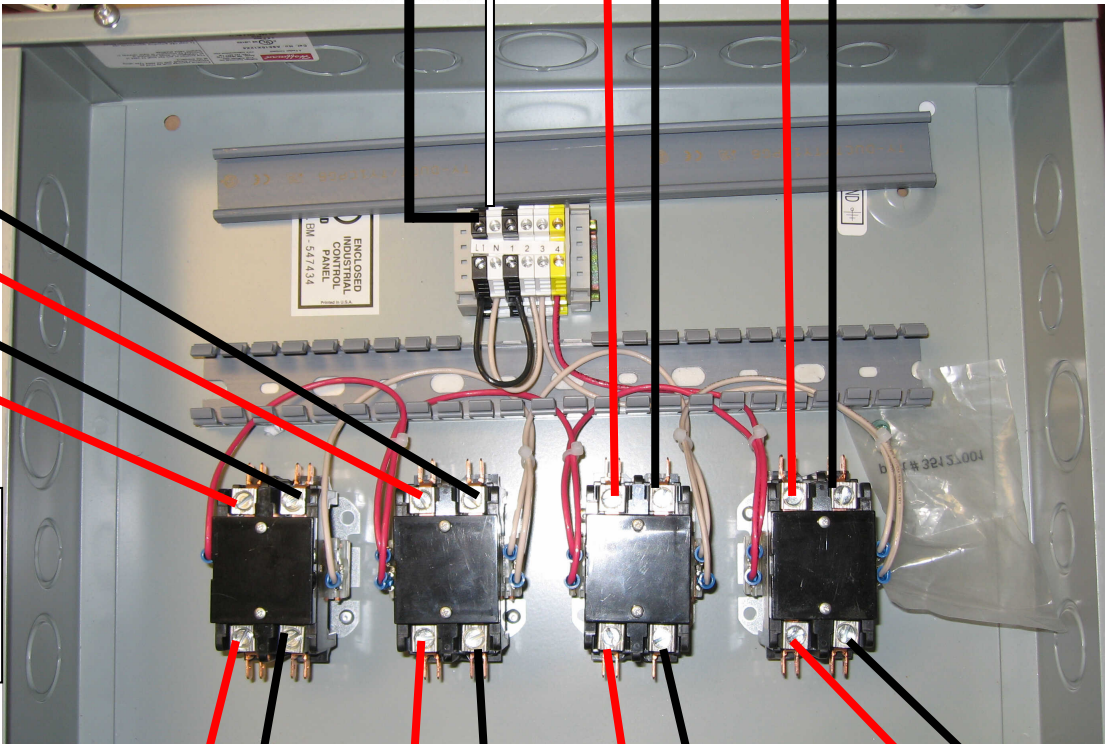

HEATERS 1 to 5
CONNECTED IN
PARALLEL

HEATERS 5 to 10
CONNECTED IN
PARALLEL

HEATERS 11 TO 15
CONNECTED IN
PARALLEL

HEATERS 16 to 20
CONNECTED IN
PARALLEL

SPEEDHEAT US
1-888-WARM FLOOR
Fax: 1-888-927-6357
www.speedheat.us