




From distribution board

- Hot1 (Live1)
- Hot2 (Live2)
- Ground
- Neutral

Tie off and insulate

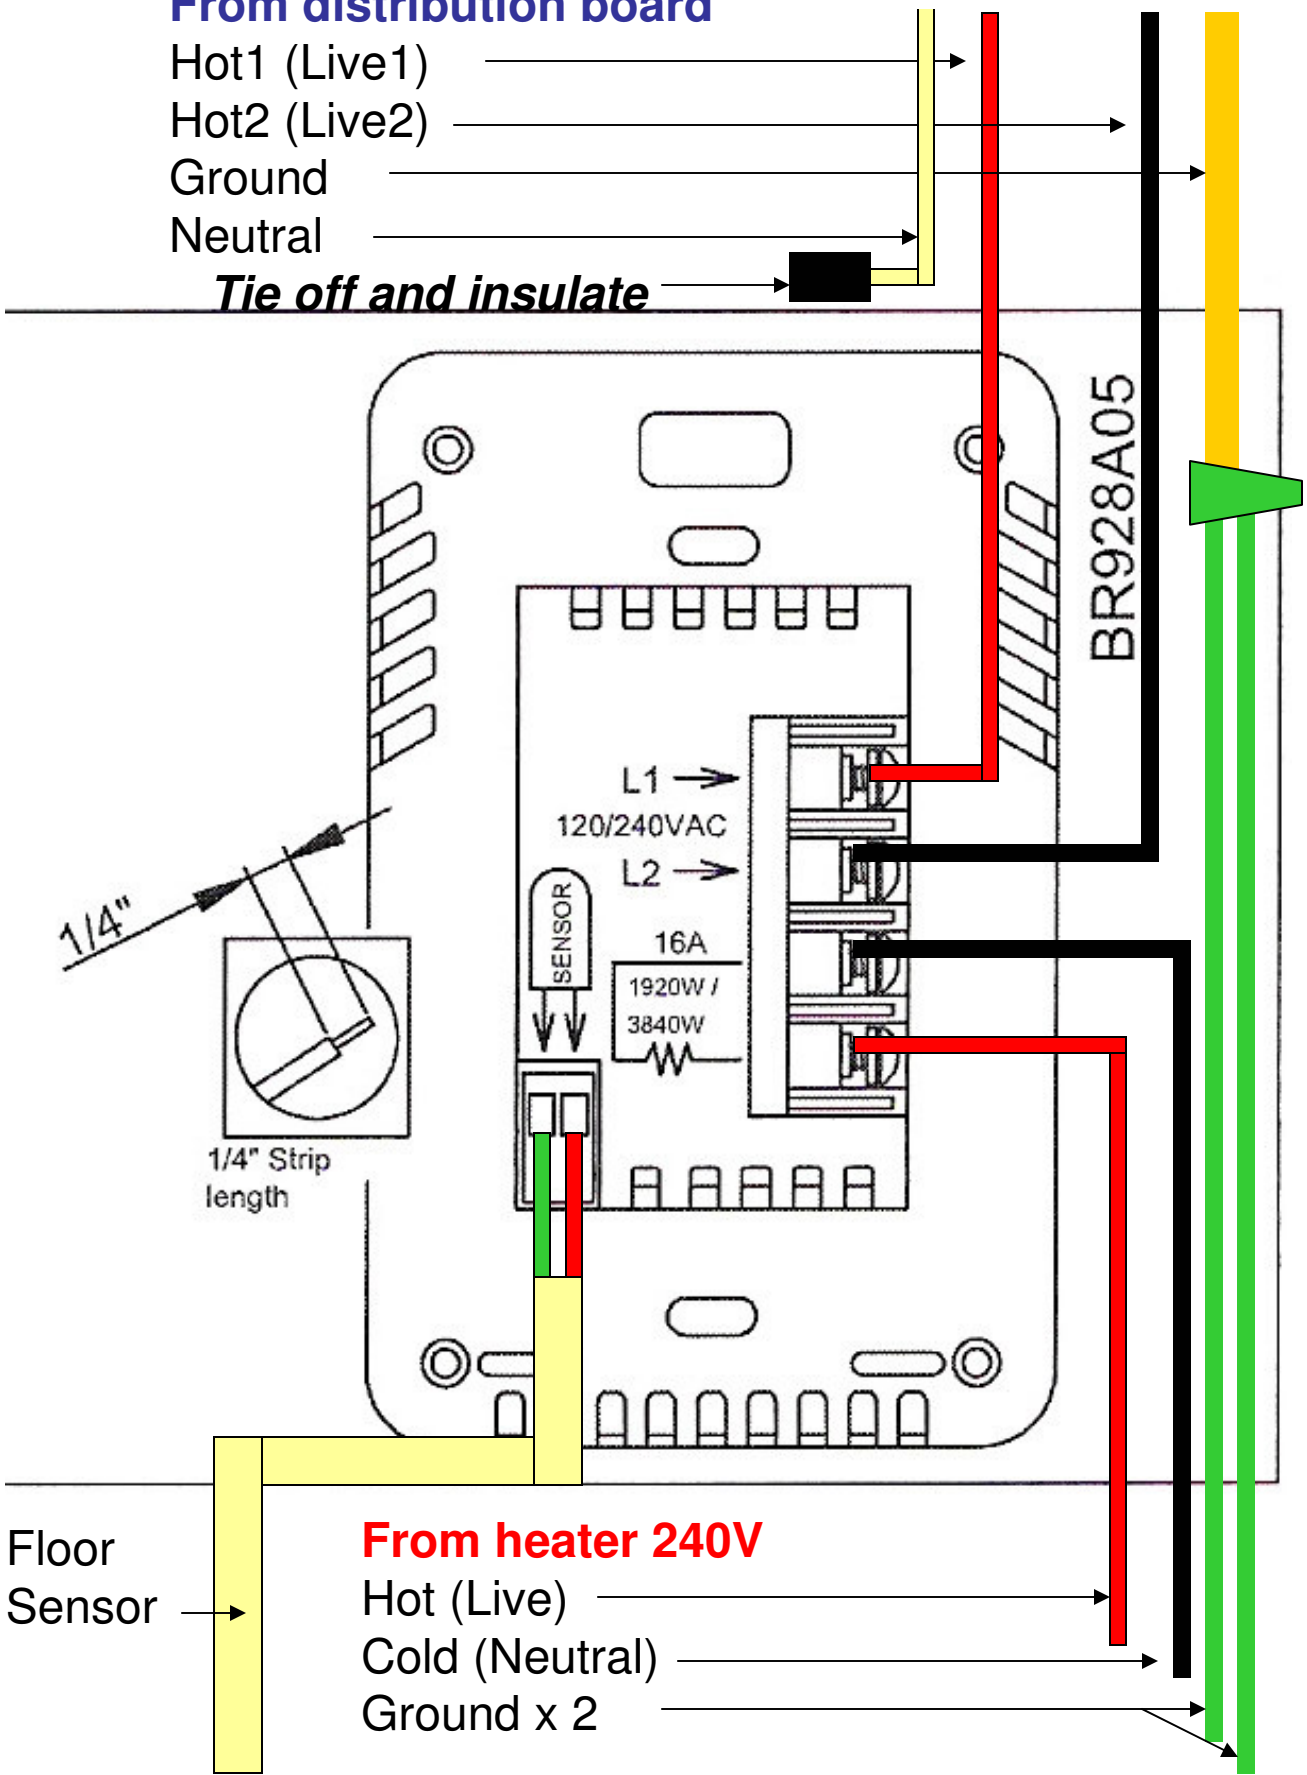

From heater 240V

- Floor Sensor
- Hot (Live)
- Cold (Neutral)
- Ground x 2